
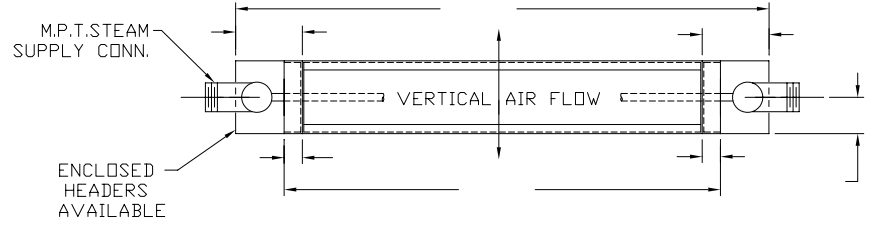
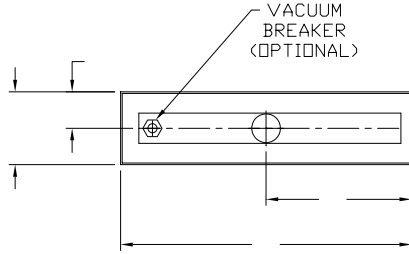


TUBING
(MAT'L./SIZE) = _____ S.C.F.M.= _____
 ENT.AIR TEMP.= _____ F°
 FINS
(MAT'L.) = _____ LVG.AIR TEMP.= _____ F°
 FINS PER INCH = _____ STEAM PRESSURE = _____ (PSIG)
 ROWS DEEP = _____ AIR FRICTION = _____
 (IN DIRECTION OF AIR FLOW) (IN INCHES OF WATER)

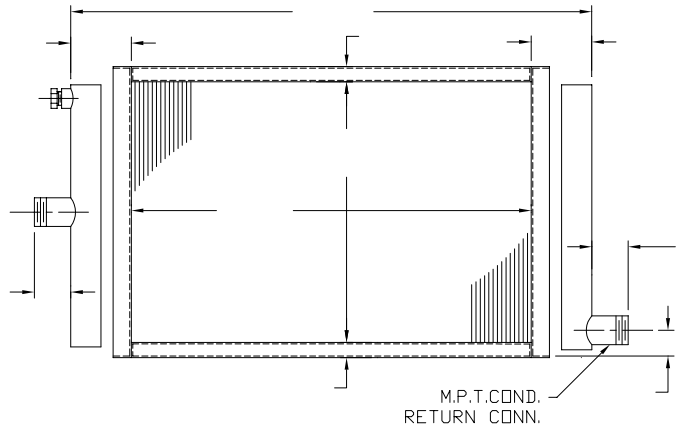

				CUSTOMER ORDER NO.	ANDERSON SNOW SHOP ORDER NO.	DRAWN BY	TYPE "STD"	
							STANDARD STEAM COIL (VERTICAL AIR FLOW)	
							FOR	
							(OPPOSITE END CONN'S.)	
DATE	SYM.	REVISION RECORD	DR.	CK.	JOB NAME		ANDERSON-SNOW CORPORATION	DRAWING NO.
							-SCHILLER PARK, ILLINOIS 60176-	CAT. 002
		TEST PRESSURES					ALL DIMENSIONS ARE ± 1/8"	
		PRELIMINARY AIR TEST	PSIG	AIR UNDER WATER				
		FINAL FAB AIR TEST	PSIG	AIR UNDER WATER				
		FINAL TEST PRESSURES	PSIG					
		MAXIMUM OPERATING PRESSURE	PSIG	°F				